



Meridian Fire Department

EVOC#

05P

Driver/Operator Performance Standards

Revision Date: 5/30/2024

Standard:
 NFPA 1002-17: 4.3.5
 NFPA 1002-17: 4.3.6

Description: Maneuver a fire department pumping apparatus into an alley/side street with an offset access opening


Conditions: Given a fire department pumping apparatus, safety spotter, cones, and a course that requires the candidate to maneuver an apparatus into an alley/side street with an offset access opening, the candidate shall maneuver the apparatus so no cones are struck.

Time Standard: 5:00 minutes

Time Adjustments: N/A

Time:

Course Diagram

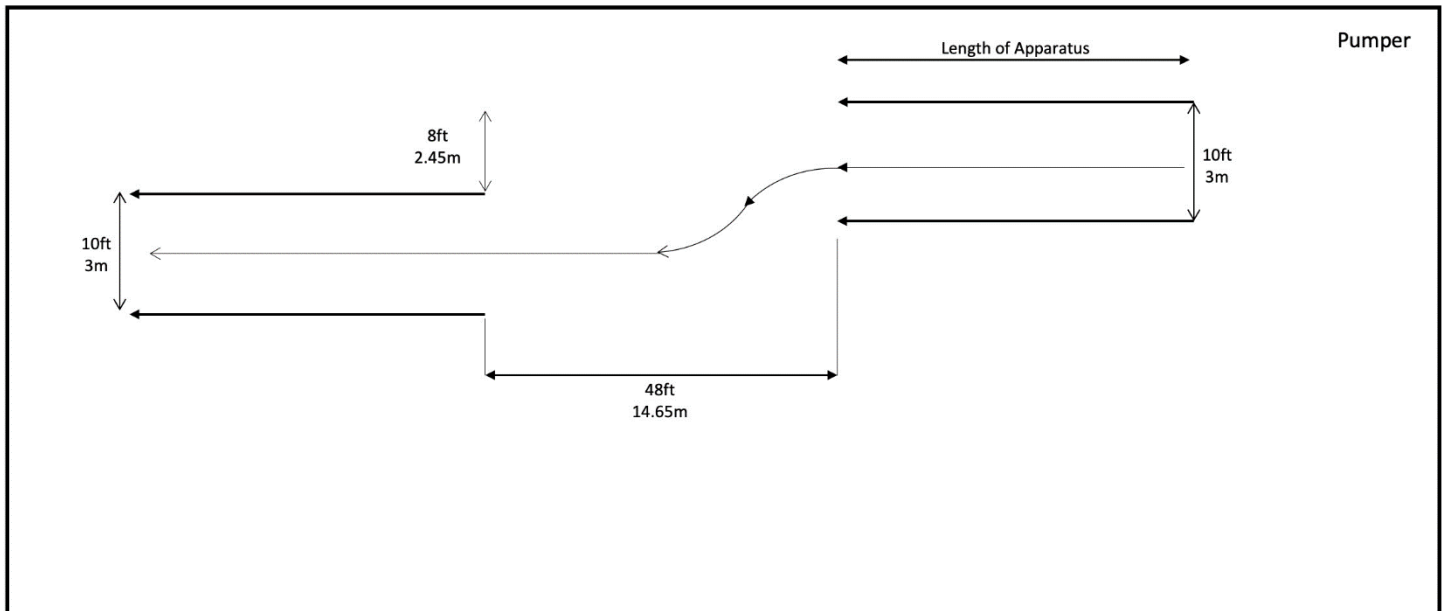

Critical Competencies:

Pass

Fail

1. Adjusts and use mirrors for backing
2. Ensures all personnel are seated with safety belts
3. Uses spotter to back apparatus safely
4. Skill completed correctly without crossing over or striking cones
5. Skill completed within allotted time

Driver/Operator

Date:

Evaluator

Date: